


RP BACKFLOW PREVENTION ASSEMBLY OR
DOUBLE CHECK DETECTOR VALVE PER
VOLUSIA COUNTY REQUIREMENT

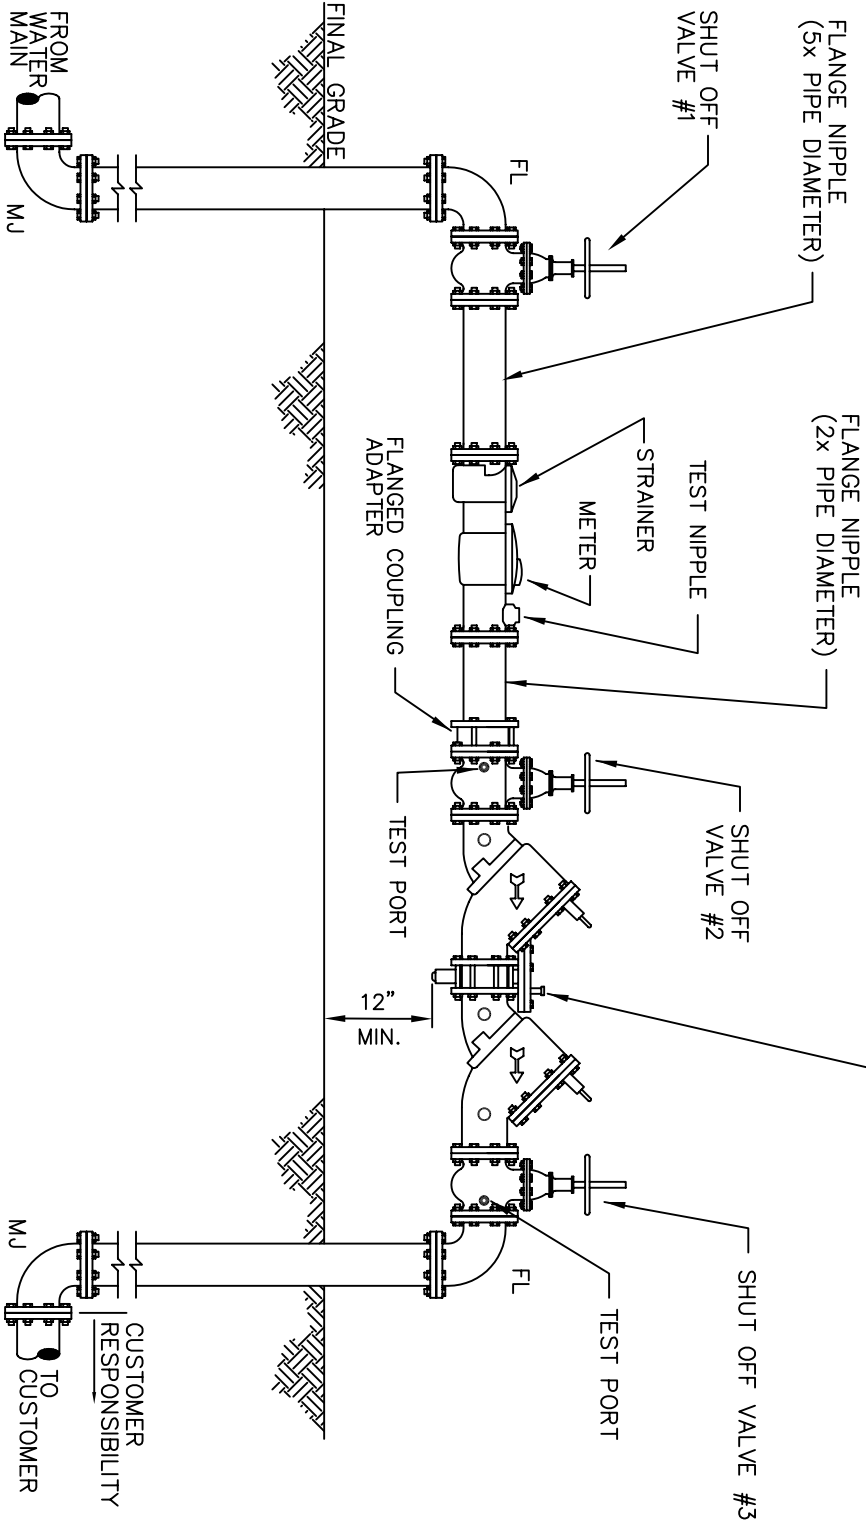

ABOVE GROUND METER SET 3" AND LARGER
WITH BACKFLOW PREVENTER DEVICE