



STANDARD DROP MANHOLE

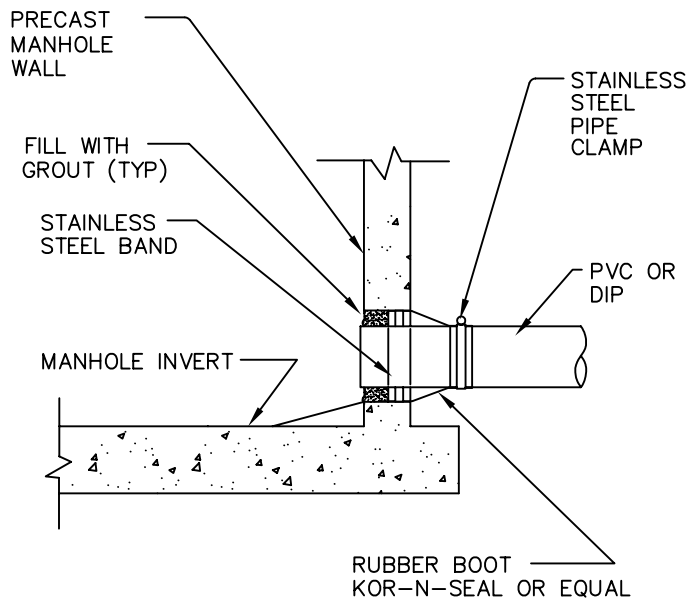

STANDARD PRECAST MANHOLE
PIPE CONNECTION

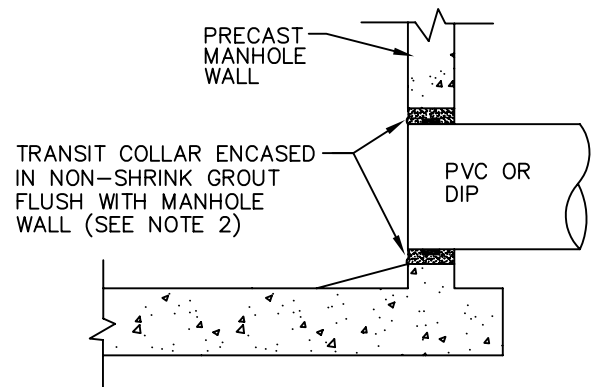

SPECIAL DETAIL FOR 24"
DIA. PIPE OR LARGER

NOTES:

1. DROP PIPE AND FITTINGS SHALL BE OF EQUAL SIZE AND MATERIAL AS THE INFLUENT SEWER.
2. THE COUNTY MAY APPROVE ALTERNATE WATER TIGHT CONNECTION DETAILS FOR CONNECTION OF 24" DIA. PIPES AND LARGER.
3. AN OUTSIDE DROP CONNECTION SHALL BE REQUIRED FOR ALL INFLUENT WHICH HAVE AN INVERT 18" OR MORE ABOVE THE MANHOLE INVERT.

MANHOLE CONNECTION DETAILS