


For SI units, 1 ft = 0.3048 m

Note 1: 5 ft minimum front relief valve in any direction away from any exterior source of ignition, openings into direct-vent appliances, or mechanical ventilation air intakes. Refer to 6.3.7(2).

Note 2: If the cylinder is filled on site from a bulk truck, the filling connection and vent valve must be at least 10 ft from any exterior source of ignition, openings into direct-vent appliances, or mechanical ventilation air intakes. Refer to 6.3.10.


Note 3: Refer to 6.3.7(1).

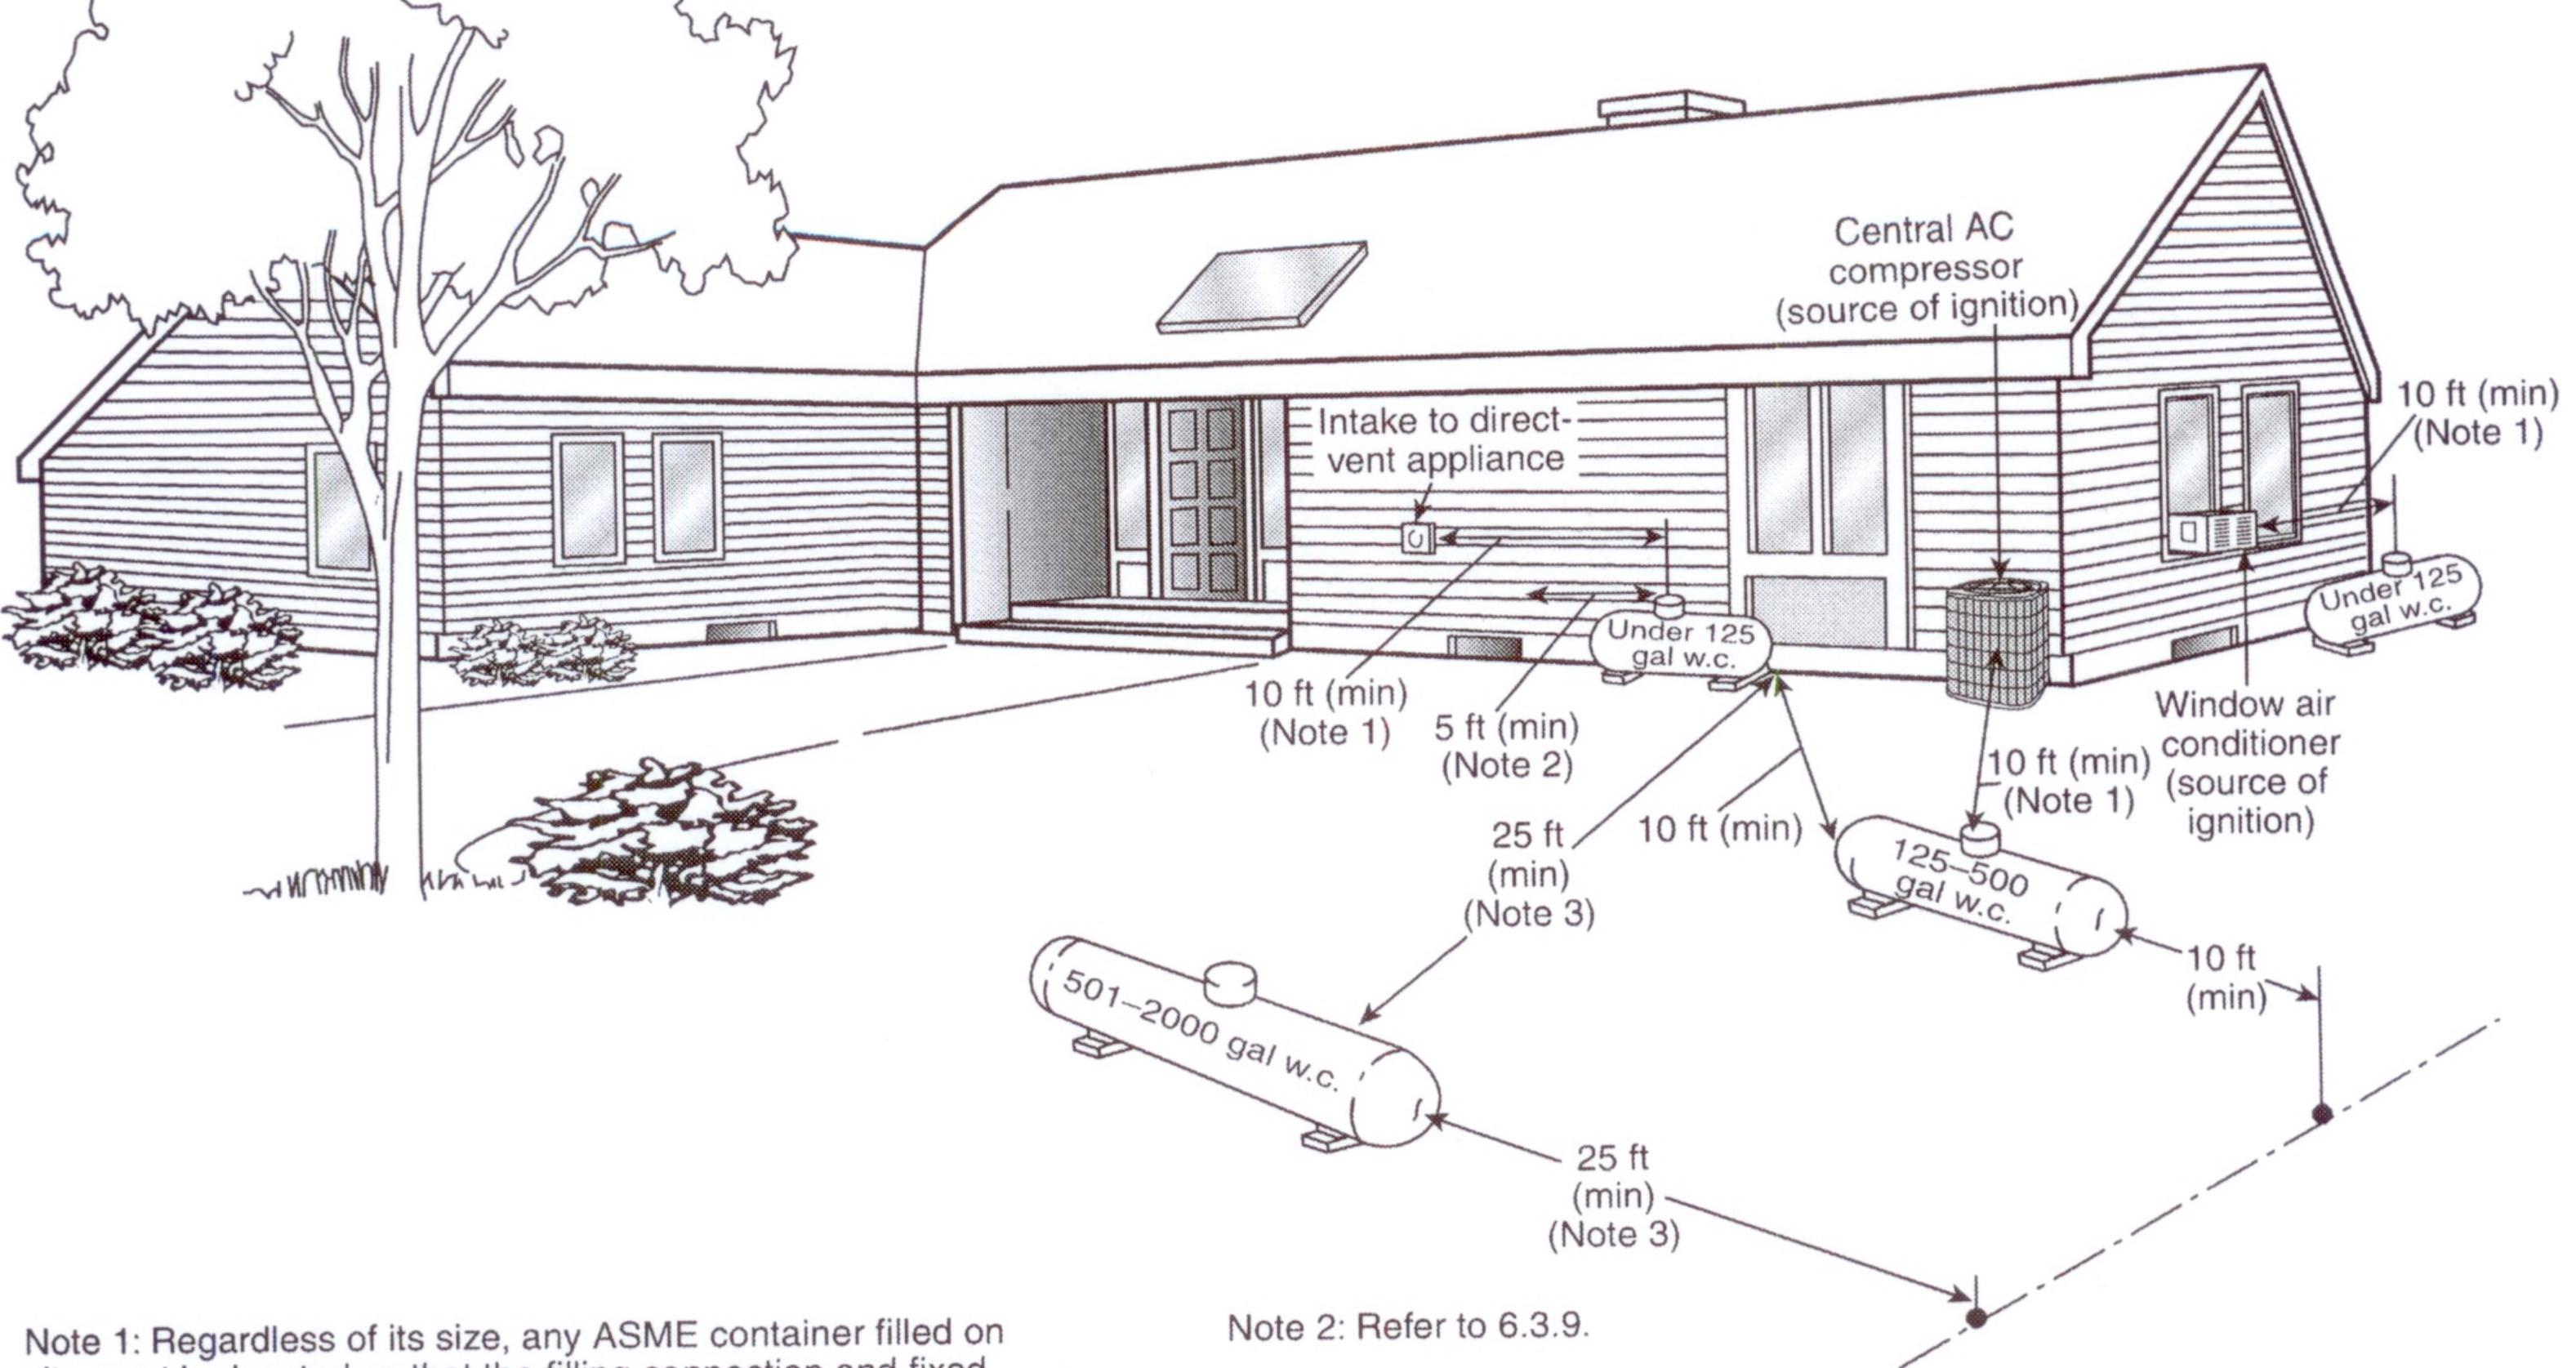

Note 1: Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft from any external source of ignition (e.g., open flame, window AC, compressor), intake to direct-vented gas appliance, or intake to a mechanical ventilation system. Refer to 6.3.10.

Note 2: Refer to 6.3.9.

Note 3: This distance can be reduced to no less than 10 ft for a single container of 1200 gal (4.5 m^3) water capacity or less, provided such container is at least 25 ft from any other LP-Gas container of more than 125 gal (0.5 m^3) water capacity. Refer to 6.3.3.

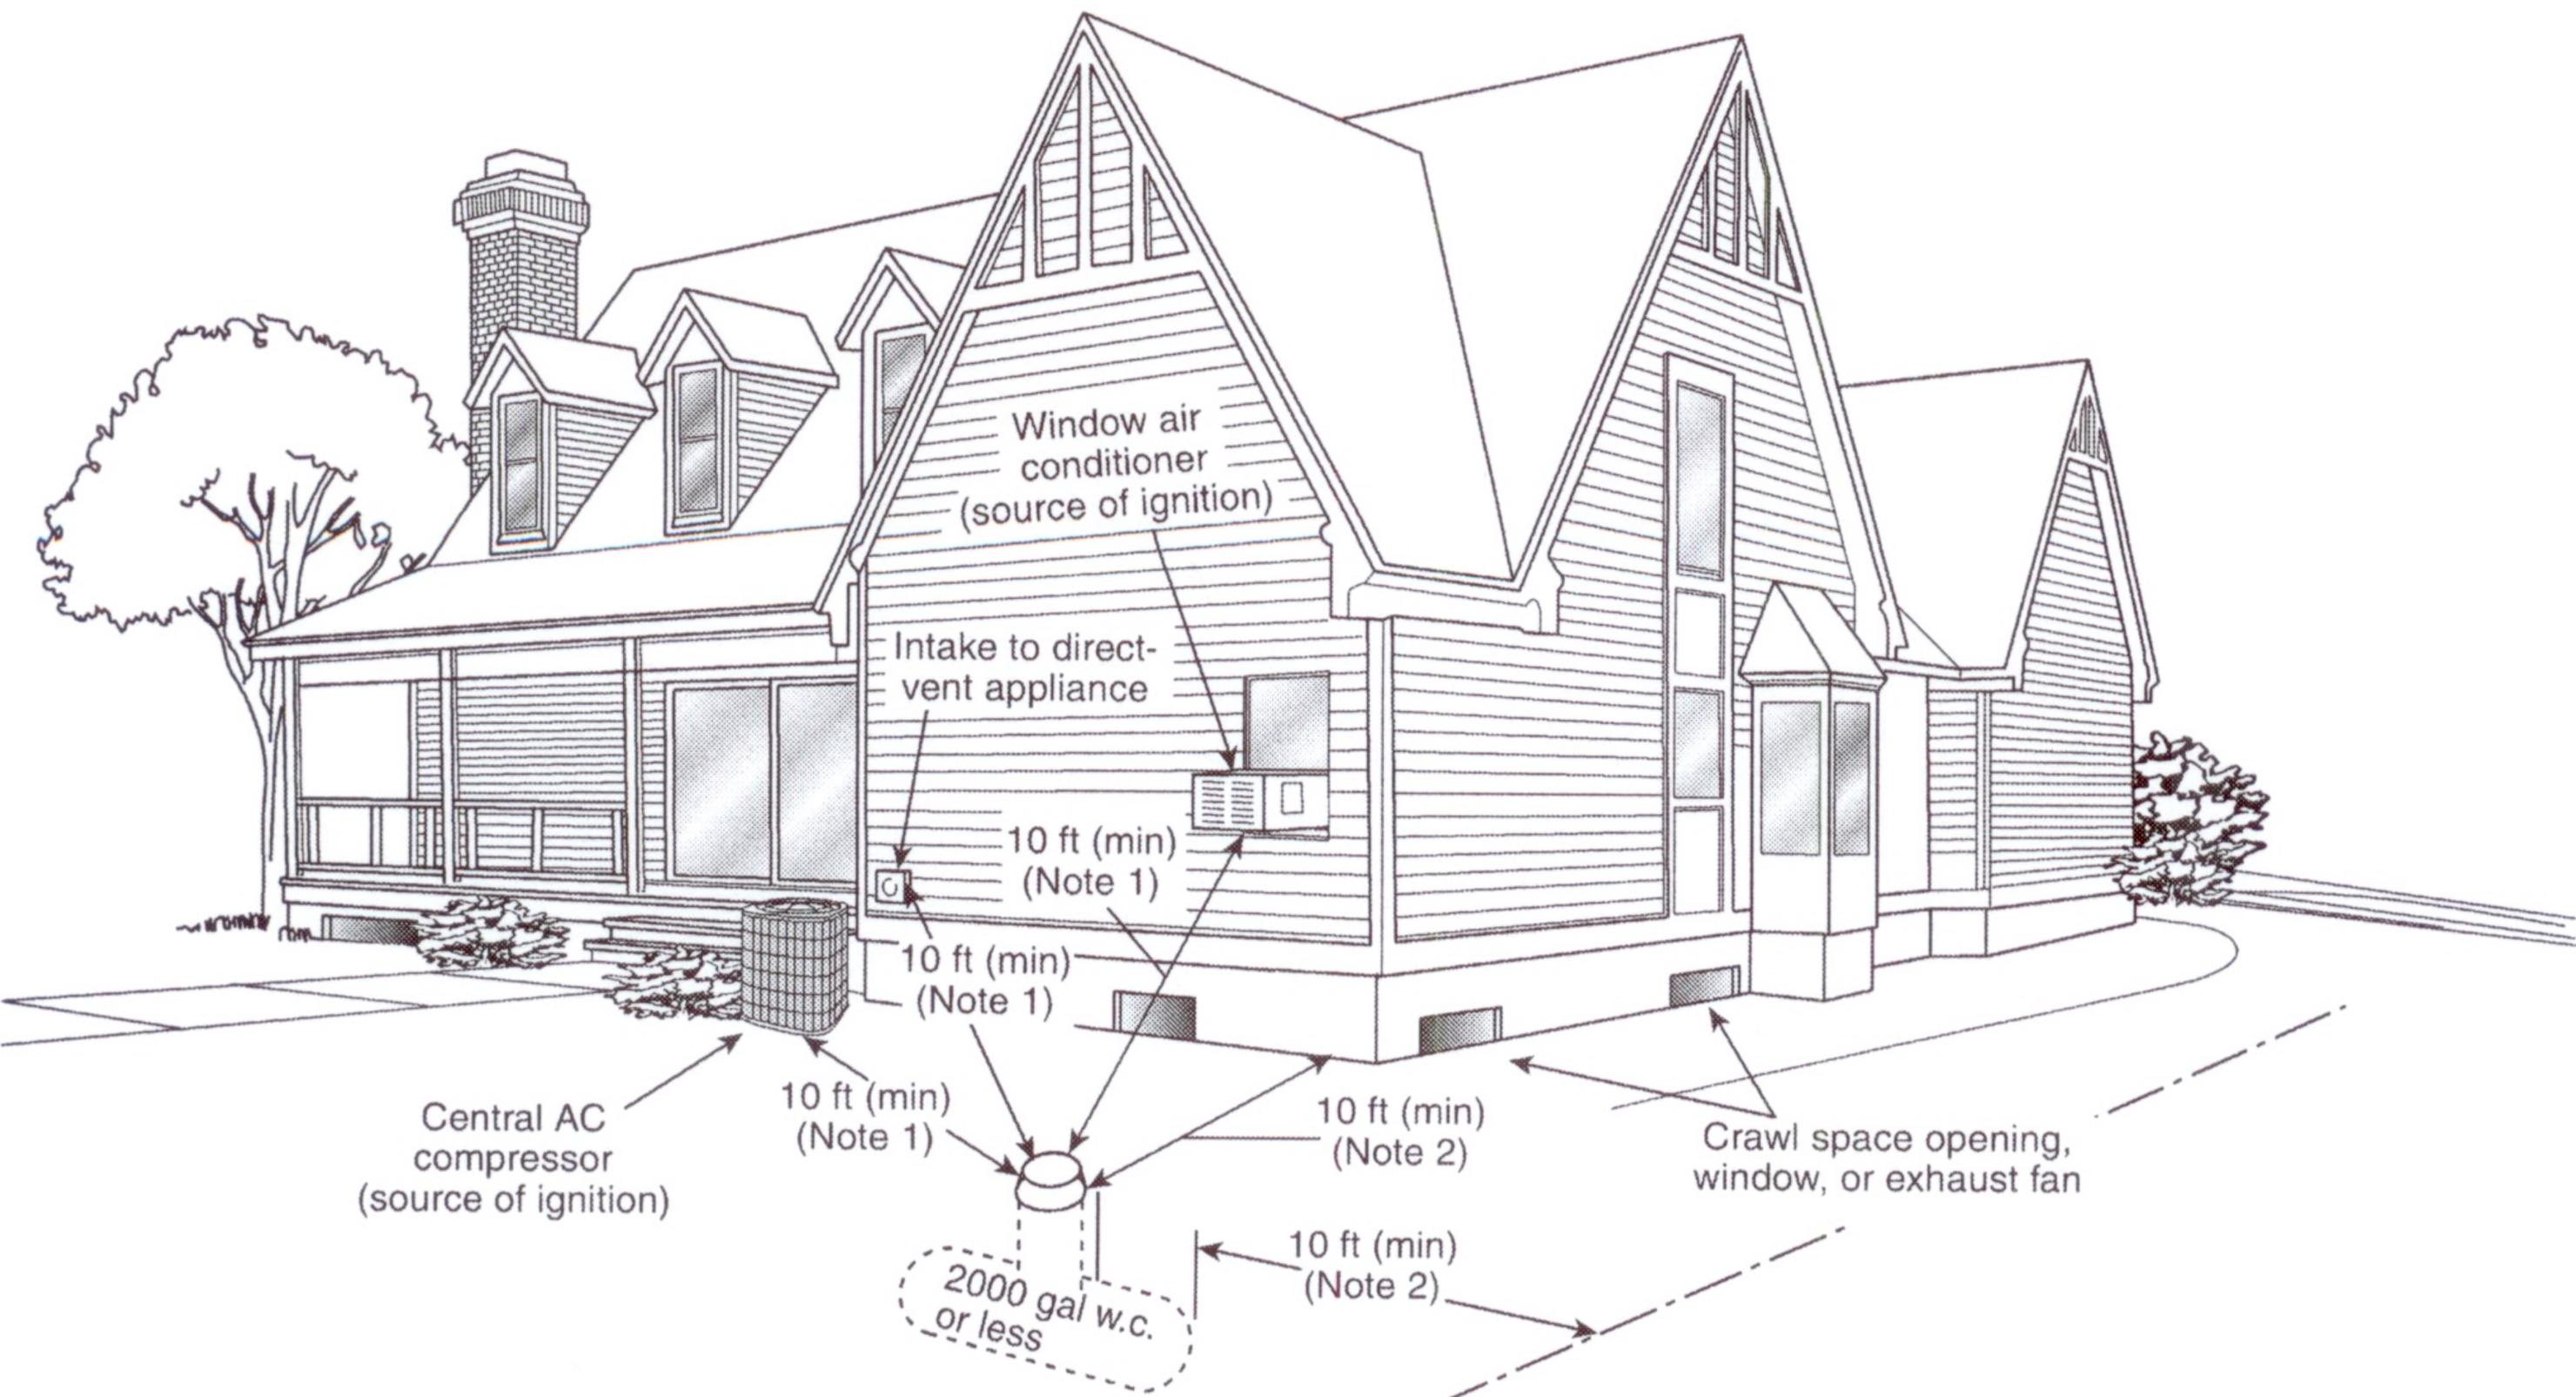

Central AC compressor (source of ignition)

2000 gal w.c. or less

Nearest line of adjoining property that can be built upon

Note 1: The relief valve, filling connection, and fixed maximum liquid level gauge vent connection at the container must be at least 10 ft from any exterior source of ignition, openings into direct-vent appliances, or mechanical ventilation air intakes. Refer to 6.3.10.

Note 2: No part of an underground container can be less than 10 ft from an important building or line of adjoining property that can be built upon. Refer to 6.3.4.2.

For SI units, 1 ft = 0.3048 m